



- Meets or exceeds NFPA/ANSI Standards and ADA Accessibility Guidelines
- UL Listed for ceiling and wall mounting
- Screw terminal capacity up to AWG #12
- Designed for use in sleeping and non-sleeping areas
- Selectable settings: 30cd, 75cd, or 110cd output
- Horn field selectable tones: 3000 Hz interrupted or electro-mechanical Temporal or non-temporal High or low dBA output
- Mounts to 4" square, single gang, double gang, or octagonal back box; SPC-1 (retrofit plate) and RBX-1 (back box skirt) are optional
- Tamper-proof candela selector switch
- Synchronization requires SMD10-3A Sync module
- Available in red or white housing

The SH24C series features a unique candela intensity field selector switch for alternating the candela to 30cd, 75cd, or 110cd. The horn provides two different field selectable tones, and a high/low output setting that can be achieved with the use of mini-jumpers located on the back of the unit. These appliances are polarized for connecting to supervised fire alarm circuits. The strobe is designed with a xenon flash tube and provides a candela intensity field selector switch for maximum performance.

The SH24C-3075110 can be synchronized by using the SMD10-3A Sync Module to comply with NFPA recommendations concerning photosensitive epilepsy when installing more than two visual appliances within the field of view. The strobe signals are listed for indoor use, wall mount, under UL 1971 Standard and are ADA compliant.


Engineering Specifications

The audible and visual alarm indicating appliances shall be Potter Model SH24C-3075110 or equivalent device. The strobe shall be listed under UL 1971 Standard for signaling devices for the hearing impaired and shall be approved for fire protective service. The candela output shall be field selectable, having three settings of 30cd, 75cd, and 110cd output. The signaling strobe shall operate on 24V DC from a non-coded, regulated DC supply or full-wave rectified, unfiltered supply. The horn may operate on a 24V DC coded system. The strobe shall be designed to produce one signal flash per second with continuously applied minimum voltage. The strobe/horn may have a SPC-1 universal back mounting plate, capable of ceiling and wall mounting to a back box. When strobe synchronization is required, the strobe/horn shall be compatible with the Potter SMD10-3A (daisy chain) or other source of Potter sync protocol. Audible and visual signaling devices shall be installed in accordance with current NFPA guidelines.







Ordering Information

Model Number	Stock Number	Housing Color	Input Voltage	Operating Voltage Range	Selectable Strobe Output (cd)	Horn Sound Output	Flash Rate	Mounting Type	Operating Temperature Range
SH24C-3075110R	4570003	Red	Regulated 24V DC/ FWR	16-33 VDC 16-33 VFWR	30,75,110	Selectable	60 times/min.	Ceiling and Wall	32°F - 120°F (0°C - 49°C)
SH24C-3075110W	4570004	White							

Dimensions: inches (mm)

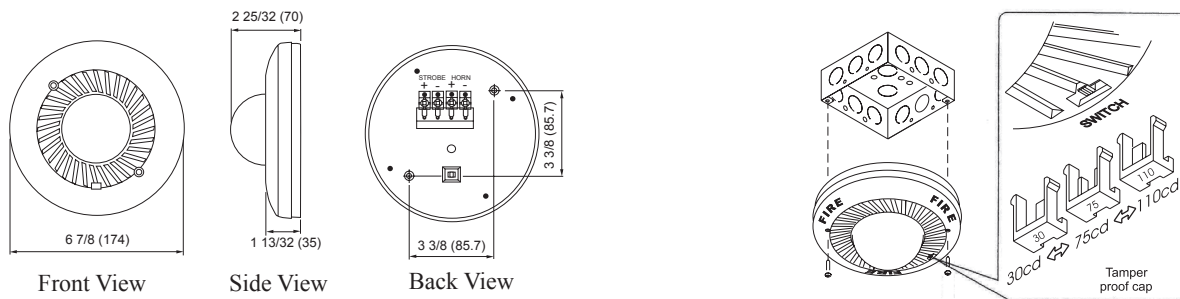

Wiring Diagram

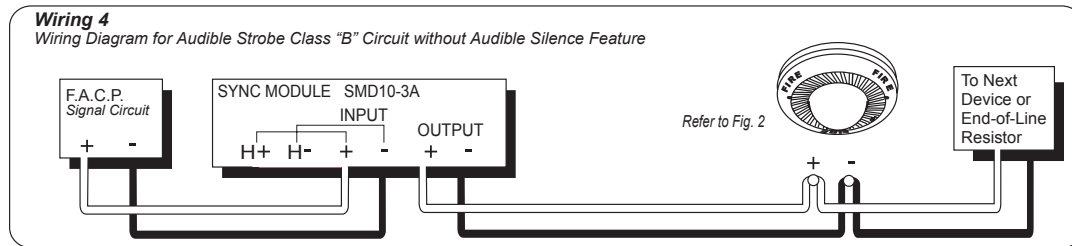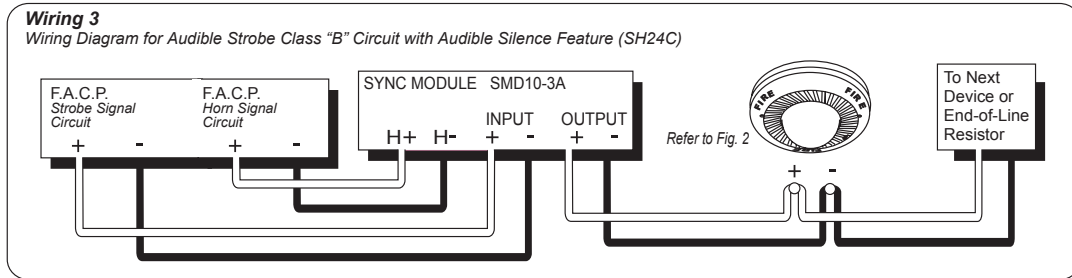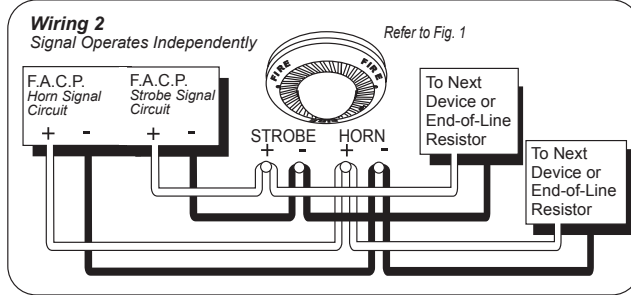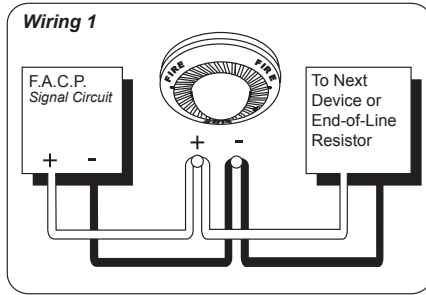


UL Required Minimum Light Output		Ceiling Mount		
		30cd	75cd	110cd
DEGREES	0	30.00	75.00	110.00
	5-25	27.00	67.50	99.00
	30-45	22.50	56.25	82.50
	50	16.50	41.25	60.50
	55	13.50	33.75	49.50
	60	12.00	30.00	44.00
	65-70	10.50	26.25	38.50
	75-80	9.00	22.50	33.00
	85-90	7.50	18.75	27.50
	Compound 45	7.20	18.00	26.40



DEGREES	Sound Output Dispersion (dB)	Horizontal	Vertical
	+90	-2	-5
	+60	0	-2
	+30	1	-1
	0	0	0
	-30	-2	-1
	-60	-3	-2
	-90	-6	-5

Specifications

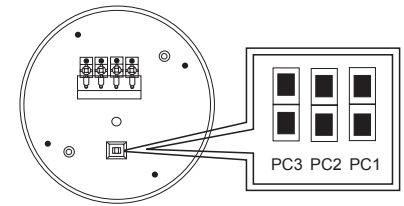Strobe/Horn Current Draw Table				PC3: Pattern PC2: Tone PC1: Volume			Maximum RMS Operating Current (mA)		Minimum Sound Output (dBA at 10ft per UL464)
				PC3	PC2	PC1	Regulated 24V DC (Typical)	Regulated 24V FWR (Typical)	Regulated 24V DC
Horn & Strobe 30cd	Non-Temporal	Electro Mechanical	HIGH	1	1	1	160 (127)	203 (171)	86
		3000 Hz	LOW	1	1	0	138 (108)	189 (152)	76
		Electro Mechanical	HIGH	1	0	1	160 (127)	203 (171)	87
		3000 Hz	LOW	1	0	0	138 (108)	189 (152)	77
	Temporal	Electro Mechanical	HIGH	0	1	1	160 (127)	203 (171)	80
			LOW	0	1	0	138 (108)	189 (152)	73
		3000 Hz	HIGH	0	0	1	160 (127)	203 (171)	82
			LOW	0	0	0	138 (108)	189 (152)	74
Horn & Strobe 75cd	Non-Temporal	Electro Mechanical	HIGH	1	1	1	218 (167)	276 (220)	86
			LOW	1	1	0	201 (148)	262 (201)	76
		3000 Hz	HIGH	1	0	1	218 (167)	276 (220)	87
			LOW	1	0	0	201 (148)	262 (201)	77
	Temporal	Electro Mechanical	HIGH	0	1	1	218 (167)	276 (220)	80
			LOW	0	1	0	201 (148)	262 (201)	73
		3000 Hz	HIGH	0	0	1	218 (167)	276 (220)	82
			LOW	0	0	0	201 (148)	262 (201)	74
Horn & Strobe 110cd	Non-Temporal	Electro Mechanical	HIGH	1	1	1	273 (202)	348 (267)	86
			LOW	1	1	0	256 (183)	334 (248)	76
		3000 Hz	HIGH	1	0	1	273 (202)	348 (267)	87
			LOW	1	0	0	256 (183)	334 (248)	77
	Temporal	Electro Mechanical	HIGH	0	1	1	273 (202)	348 (267)	80
			LOW	0	0	0	256 (183)	334 (248)	73
		3000 Hz	HIGH	0	1	1	273 (202)	348 (267)	80
			LOW	0	0	0	256 (183)	334 (248)	74



Back of SH24C

	Tone Selection	PC3 Pattern	PC2 Tone	PC1 Volume
Jumper		Non- Temporal	Electro- Mechanical	High
		Temporal	3000Hz	Low


Strobe Light Only	Max. RMS operating Current (mA)	
	Regulated 24V DC (Typical)	Regulated 24V FWR (Typical)
30cd	121 (88)	169 (124)
75cd	178 (128)	244 (178)
110cd	242 (166)	304 (226)

⚠ WARNING

Strobes must be used only on circuits with continuously operating voltage. DO NOT use strobe on coded or interrupted circuits in which the applied voltage is interrupted ON and OFF as the strobe may fail to flash. The applied voltage must be within its rated input voltage range. Fuse ratings on signaling circuits must handle peak currents from all devices connected to those circuits.

Horn Only Current Draw and Output Table			PC3: Pattern PC2: Tone PC1: Volume			Max. RMS Operating Current (mA)		Min. sound Output (dBA @ 10ft. per UL 464)
			PC3	PC2	PC1	Regulated 24V DC	Regulated 24V FWR	Regulated 24V DC
Non-Temporal	Electro-Mechanical	HIGH	1	1	1	49	45	86
		LOW	1	1	0	34	34	76
	3000 Hz	HIGH	1	0	1	49	45	87
		LOW	1	0	0	34	34	77
Temporal	Electro-Mechanical	HIGH	0	1	1	49	45	80
		LOW	0	1	0	34	34	73
	3000 Hz	HIGH	0	0	1	49	45	82
		LOW	0	0	0	34	34	74

Optional Mounting (using SPC-1 retrofit plate)

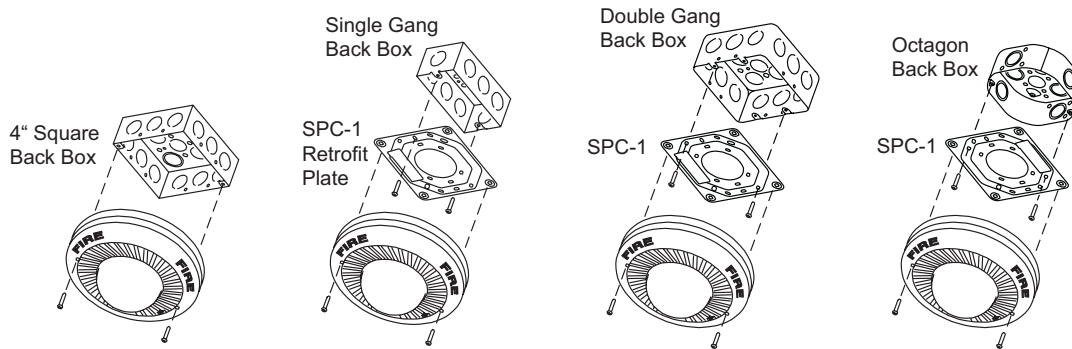

Optional Surface Mounting (using RBX-1 back box skirt and SPC-1 retrofit plate)

