

INSTALLATION INSTRUCTIONS

**POTTER TYPE 4X/3R WEATHERPROOF MULTI-TONE STROBE,
WITH PRE-WIRE/PRE-TEST
WALL/CEILING MOUNT (BLUE, GREEN OR RED LENS)**

Use this product according to this instruction manual. Please keep this instruction manual for future reference.

GENERAL:

The Potter Electric 4X/3R weatherproof series PE-4XMTST/PE-3RMTST Multi-Tone Strobe appliances are designed for easy installation with a pre-wire capable PE-4XBB surface box or PE-3RMP mounting plate. PE series 4X/3R Multi-Tone Strobe (Blue, Green or Red) is UL Listed under Standard UL1638 for Visual Signaling Devices and Standard 464 for Audible Signaling Devices. PE series 4X/3R Multi-Tone is also ULC Listed under Standard ULC526 for Visual Signaling Devices and under Standard ULC525 for Audible Signaling Devices for Fire Alarm Systems. All models are listed for indoor/outdoor use, and for wall or ceiling mount.

Potter Multi-Tone appliances can be field set to produce any one of eight commonly used alarm tones. Sound output can be field set to provide either HIGH (HI) dBA or STANDARD (STD) dBA sound output level. Potter Multi-Tone appliances are designed for use with either filtered or unfiltered Full-Wave-Rectified (FWR) input voltage. All inputs are polarized for compatibility with standard reverse polarity supervision of circuit wiring by a Fire Alarm Panel (FACP). The horn portion of the Multi-Tone appliance can be field set to provide a synchronized code 3 horn when used in conjunction with Wheelock Sync.

The Potter PE series meets NFPA 2016 20 millisecond light pulse duration code requirements. The maximum number of PE series devices per NAC is determined by dividing the maximum current rating of the FACP NAC by the total current rating of one PE series device, with a maximum of 105 PE series strobe devices per NAC. Refer to FACP installation instructions for more detail.

The Potter PE series Multi-Candela Strobes provides a synchronized strobe appliance when used in conjunction with an FACP or power supply that incorporates the Wheelock Sync protocol.

CAUTION: Do not change factory applied finishes. "DO NOT PAINT".

ATTENTION: Ne pas modifier les finitions appliquées en usine. "NE PAS PEINTURER"

IMPORTANT: PLEASE READ THESE INSTRUCTIONS CAREFULLY. FAILURE TO COMPLY WITH ANY OF THE FOLLOWING INSTRUCTIONS COULD RESULT IN IMPROPER APPLICATION, INSTALLATION AND/OR OPERATION OF THESE PRODUCTS IN AN EMERGENCY SITUATION, WHICH COULD RESULT IN PROPERTY DAMAGE AND SERIOUS INJURY OR DEATH TO YOU AND/OR OTHERS.

SPECIFICATIONS:

Table 1: Specifications	
Models*	PE-4XMTSTB (Blue), PE-4XMTSTG (Green), PE-4XMTSTR (Red) PE-3RMTSTB (Blue), PE-3RMTSTG (Green), PE-3RMTSTR (Red)
Agency	Strobe: UL1638, ULC526 Multi-Tone: UL464, ULC525
Input Voltage	DC or FWR, 24V Regulated, 16 to 33V (All models)
Volume Setting	STD (standard) or HI (high) (selectable via DIP switch SW1 POS1)
Tone Setting	Eight (8) selectable tones (via DIP switch SW1, POS 2,3,4)
Strobe Candela On-Axis	Strobe (Blue): 15, 30, 75, 95, 135, 150cd (field selectable) Strobe (Green): 15, 30, 60, 75, 115, 125cd (field selectable) Strobe (Red): 10, 20, 40, 50, 75, 80cd (field selectable)
NAC Characteristics	Max. line resistance: 35Ω
Environmental	Indoor/Outdoor Use. -40° C - 66° C (-40° F - 150° F) 95% R.H.

*Prefix "PE-WP" indicates "Subassembly". Requires PE-4XBB surface box or PE-3RMP mounting plate for installation.

Table 2: Strobe Current Ratings (AMPS) **						
Strobe (Blue)	15cd	30cd	75cd	95cd	135cd	150cd
Strobe (Green)	15cd	30cd	60cd	75cd	115cd	125cd
Strobe (Red)	10cd	20cd	40cd	50cd	75cd	80cd
DC	0.026	0.038	0.070	0.097	0.179	0.206
FWR	0.034	0.053	0.098	0.137	0.235	0.308

** Setting will determine the current draw of the product.

NOTES:

- The strobe will produce 1 flash per second over the "Regulated Voltage" range.
- Strobe is not designed to be used on coded systems in which the applied voltage is cycled on and off.
- The maximum number of PE series strobes on a single notification appliance circuit shall not exceed 105.
- Blue, Green, or Red Strobes are Private Mode Only**, and shall not to be used as Visual Public Mode alarm notification.
- These appliances are UL Listed as "Regulated". They are intended to be used with FACP's whose notification circuits are UL Listed as "Regulated." Refer to the FACP instructions for special application and strobe synchronization compatibility.
- The effect of shipping and storage temperatures shall not adversely affect the performance of the appliance when it is stored in the original cartons and not subjected to misuse or abuse.

When calculating the total currents: Use Table 2, 3 to determine the highest value of "RMS Current" for an individual appliance, then multiply these values by the total number of appliances; be sure to add the currents for any other appliances powered by the same source and include any required safety factors. Make sure that the total RMS current required by all appliances that are connected to the system's PRIMARY and SECONDARY power sources, NAC circuits, Sync Modules or Potter Power Supplies does not exceed the power sources' rated capacity or the current ratings of any fuses on the circuits to which these appliances are wired. Check the minimum and maximum output of the power supply and standby battery, and subtract the voltage drop from the circuit wiring resistance to determine the applied voltage to the appliance.


CAUTION: If Multi-Tone appliances are operated within 15 inches of a person's ear, they can produce a sound pressure level that exceeds the maximum 120 dBA permitted by ADA and OSHA rules. Exposure to such sound levels can result in damage to a person's hearing.

ATTENTION: Si les appareils Multi-Tone sont utilisés à moins de 15 pouces de l'oreille d'une personne, ils peuvent produire un niveau de pression acoustique supérieur à la vitesse maximale de 120 dBA permise par les règles de l'ADA et de l'OSHA. L'exposition à de tels niveaux sonores peut endommager l'ouïe d'une personne.

Table 3: Multi-Tone - Current and Sound Pressure Level Ratings				
Tone	Volume	Maximum RMS Current (AMPS)		Reverberant dBA at 10ft Per UL464/ULC525
		16-33VDC	16-33VFWR	
Horn	HI	0.108	0.087	88
	STD	0.044	0.045	83
Bell	HI	0.053	0.067	81
	STD	0.024	0.028	75
March Time	HI	0.104	0.087	88
	STD	0.087	0.045	83
Code 3 Horn	HI	0.122	0.087	88
	STD	0.035	0.045	83
Code 3 Tone	HI	0.135	0.110	81
	STD	0.035	0.032	76
Slow Whoop	HI	0.098	0.092	87
	STD	0.037	0.042	81
Siren	HI	0.104	0.092	87
	STD	0.042	0.040	81
HI/LO	HI	0.057	0.063	84
	STD	0.035	0.035	79

Table 4: Directional Characteristics	
-3dB	+/- 43 Degrees Horizontal, +/- 48 Degrees Vertical
-6dB	+/- 53 Degrees Horizontal, +/- 56 Degrees Vertical
-18dB	+/- 90 Degrees Horizontal/Vertical

WIRING DIAGRAMS:

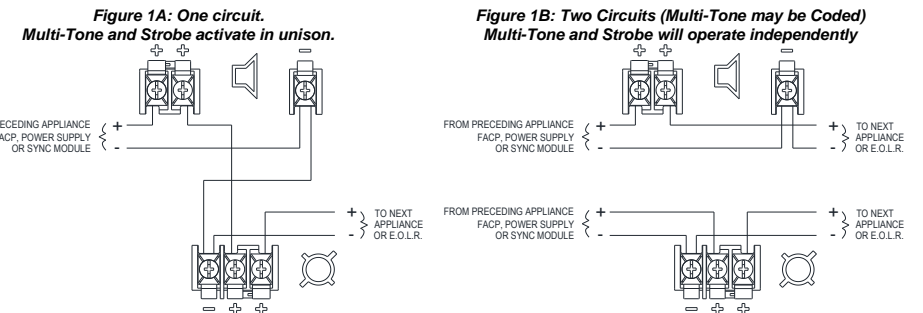

*Refer to Potter power supply or sync module instructions for additional information.

Figure 2:



- This model has in-out wiring terminals that accept two #12 to #18 American Wire Gauge (AWG) wires at each screw terminal. Strip leads 3/8 inches and connect to screw terminals.
- Break all in-out wire runs on supervised circuits to assure integrity of circuit supervision as shown in Figure 2. The polarity shown in the wiring diagrams is for operation of the appliances. The polarity is reversed by the FACP during supervision.

SETTINGS: To set Volume and Tone, use Switch (SW1). Refer to Table 5,6 and Figures 3,4.

Figure 3: Switch (SW1) located as shown





Figure 4: Switch (SW1) Settings

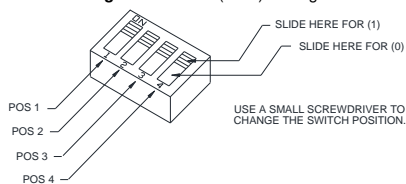

Sound Output Level	Switch SW1 Settings
High dBA	SW1 POS 1 on 1 (Factory Setting)
Standard dBA	SW1 POS 1 on 0

Table 6: Alarm Tone Settings

Tone	Pattern Description	Switch (SW1)		
		POS 2	POS 3	POS 4
Horn**	Broadband Horn (Continuous)	1	1	1
Bell	1560 Hz Modulated (0.07 Sec. ON/Repeat)	1	0	1
March Time Horn	Horn (0.25 Sec. ON/0.25 Sec. OFF/Repeat)	0	0	1
Code 3 Horn	Horn (ANSI S3.41 Temporal Pattern)	1	1	0
Code 3 Tone	500 Hz (ANSI S3.41 Temporal Pattern)	0	1	1
Slow Whoop	500-1200Hz Sweep (4 sec ON/0.5 sec OFF/Repeat)	0	1	0
Siren	600-1200Hz Sweep (1.0 Sec. ON/Repeat)	1	0	0
HI/LO	1000/800 Hz (0.25 Sec. ON/Alternate)	0	0	0

** Factory setting is Horn with Switch SW1 POS 2, 3, 4 set on 1, 1, 1.

The Code 3 Horn and Code 3 Tone incorporate the temporal pattern specified by ANSI/NFPA/ISO for standard emergency evacuation signaling. They shall be used only for fire evacuation signaling and not for any other purpose.


The Horn and Bell Tones can be used on coded systems with a minimum On-Time of 1/4 second. All other tones are recommended for use only on continuous (non-coded) systems.

The Multi-Tone must be set for Code 3 horn when used with Wheelock Sync. Refer to Potter power supply instructions for additional information concerning Wheelock Sync.

SETTINGS: To set candela, slide the selector switch to the desired setting. See Figure 5.


Figure 5: Candela

Set from rear (PCB side). Factory Setting is 15cd or 10cd (Red).

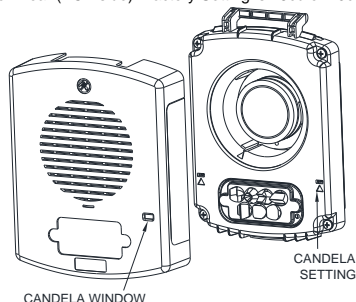

NFPA 72/ANSI 117.1 provide means for determining equivalent illumination using fewer, higher intensity strobes within the protected area.

Figure 7: Cover/Grille Removal **

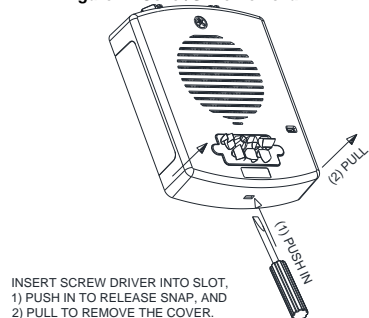

INSERT SCREW DRIVER INTO SLOT,
1) PUSH IN TO RELEASE SNAP, AND
2) PULL TO REMOVE THE COVER.

Figure 6: Light Distribution
(Expected % of Rated Candela)


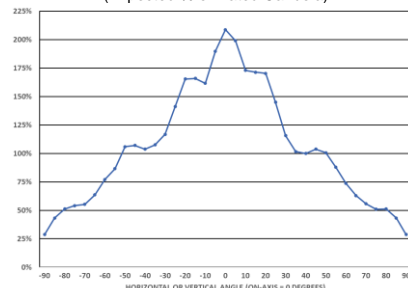


Figure 8: Type 4X/IP66 Surface Box (PE-4XBB)**

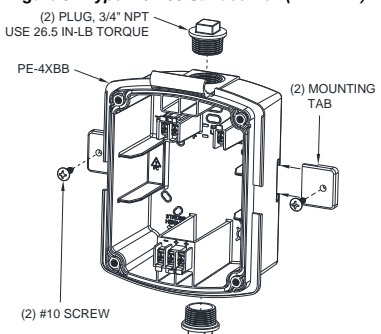

MOUNTING OPTIONS:

The following figures (A and B) show the maximum number of field wires (conductors) that can enter the backbox used with each mounting option. If these limits are exceeded, there may be insufficient space in the backbox to accommodate the field wires and stresses from the wires could damage the product.

Check that the installed product will have sufficient clearance and wiring room prior to installing backboxes and conduit, especially if sheathed multiconductor cable or 3/4" conduit fittings are used.

Figure A: Type 3R/IP54 Flush Mount (PE-3RMP)**


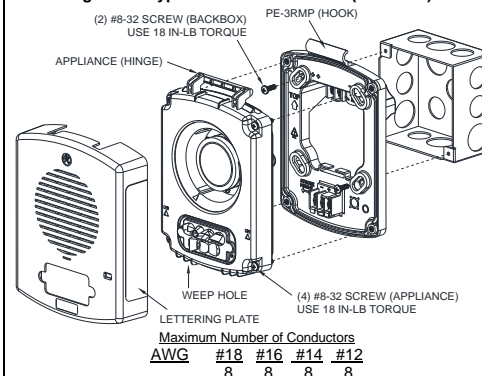


Figure B: Type 4X/IP66 Surface Mount (PE-4XBB)**

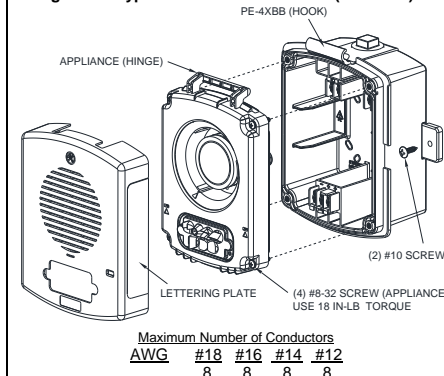

All installations shall be in accordance with:

- 1) In the United States, the National Electrical Code, NFPA 70, and the National Fire Alarm and Signaling Code, NFPA 72.
- 2) In Canada, CSA C22.1, Canadian Electrical Code, Part I, Safety Standard for Electrical Installations, Section 32; and the Canadian Standard for the Installation of Fire Alarm Systems ULC524.

MOUNTING PROCEDURES:

1. **Preliminary Info:** Use PE-3RMP for flush mount, or PE-4XBB for surface mount. Screws are provided for installation. Conduit entrances to the backbox should be selected to provide sufficient wiring clearance for the installed product. Do not pass additional wires (used for other than the signaling appliance) through the backbox. Such additional wires could result in insufficient wiring space for the signaling appliance.
2. **A: Install the PE-3RMP Mounting Plate** on the 4" square 2-1/8" deep backbox (flush mount only) using 8-32 screws. PE-3RMP is suitable for mounting to brick, ceramic tile, concrete and masonry surfaces. For Type 3R/IP54 wall mount applications, a weep hole knock-out is provided below the strobe. See Figure A. To open the weep hole knock-out (1/8" dia.), use a small screwdriver.
B: Install the PE-4XBB Back Box – Two external mounting tabs must be used along with two #10 screws (provided). See Figure 6. Mounting hole spacing is 5-9/16". Conduit fittings must be rated Type 4X/IP66 and UL certified. Installer must ensure ground continuity when metallic conduit is used. Teflon tape must be used on all conduit fittings. 3/4" NPT Plugs must be installed using Teflon tape and O-Ring (provided). Secure NPT plug with **26.5 in-lb torque**.
Note: "HOOK" must be on top for wall mounting.
3. **Pre-Wire: Connect field wires to terminals** on PE-3RMP or PE-4XBB (reference Figure 1 and 2). Use care and proper techniques to position the field wires in the backbox so that they use minimum space and produce minimum stress on the product. This is especially important for stiff, heavy gauge wires and wires with thick insulation or sheathing. When terminating field wires, do not use more lead length than required. Excess lead length could result in insufficient wiring space for the signaling appliance.
4. **Pre-Test: PE-3RMP and PE-4XBB contain a SHUNT** between adjacent "+" terminals to facilitate testing before device is attached.
Note: Shunt will open permanently when device is installed.
5. **Verify appliance settings** are correct for your application. Settings are shown in Fig. 3-5. Factory settings are HI dBA, Horn, min cd.
6. **Place the appliance "HINGE"** over the "HOOK" on the PE-3RMP or PE-4XBB. Verify the appliance is aligned, then secure with four #8-32 screws attached to appliance with **18 in-lb torque**. Verify the gasket is seated correctly and not "pinched".
7. **Align grille with lettering plates** to the appliance and snap in place. (Note: Insert letter plates with "T" tab down on strobe/logo-side).
8. **Recommend** applying outdoor rated silicone to all outdoor Type 4X/3R installations.
9. **To remove** the appliance grille, insert a small flat-bladed screwdriver into the bottom opening to release snap as shown in Figure 7. Then "pull" to remove the cover/grille.

Important: Do not fully back out terminal screws. Do not over tighten screws or terminals. Excessive torque may affect operation. When using power tools, ensure the torque is set to the lowest setting available.

NOTE: Final acceptance is subject to Authorities Having Jurisdiction.

Check the installation instructions of the manufacturers of other equipment used in the system for any guidelines or restrictions on wiring and/or locating Notification Appliance Circuits (NAC) and notification appliances. Some system communication circuits and/or audio circuits, for example, may require special precautions to assure immunity from electrical noise (e.g. audio crosstalk).

This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications. Operation of this equipment in a residential area is likely to cause harmful interference in which case the user will be required to correct the interference at his own expense.

This Class A digital apparatus meets all requirements of the Canadian Interference-Causing Equipment Regulations. Cet appareil numérique de la classe A respecte toutes les exigences du Règlement sur le matériel brouilleur du Canada.

Any material extrapolated from this document or from Potter Electric manuals or other documents describing the product for use in promotional or advertising claims, or for any other use, including description of the product's application, operation, installation and testing is used at the sole risk of the user and Potter Electric will not have any liability for such use. IN NO CASE WILL SELLER'S LIABILITY EXCEED THE PURCHASE PRICE PAID FOR A PRODUCT.